

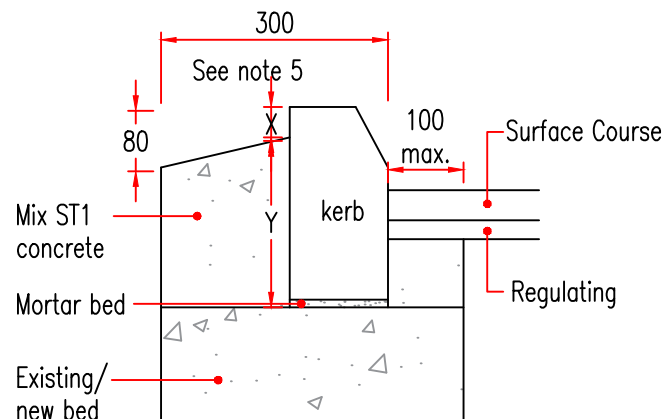


Table of Bedding Materials

Bed Depth	Material
10 – 40mm	Class 1 mortar
40 – 75mm	Class 7.5/10 Concrete
50 – 150mm	Mix ST4 Concrete

NOTES

- Existing level to be mechanically reduced and roughened where required to provide new bed of 10mm minimum.
- Concrete bed to be mechanically vibrated and the surface roughened to provide a key for backing.
- The backing concrete must be placed within one hour of laying the mortar bed.
- Kerbs laid to smooth horizontal and vertical alignment.
- X dependant upon treatment behind kerb. For verge 40mm Min. For footway/access = depth of surfacing.
Y to be $\frac{2}{3}$ rds kerb depth minimum unless otherwise specified.