
Jot date 03/11/2005

NOTES

- This layout shown for attenuation pond or basin to be laid to the basin profile. (This type of headwall can be used as a straight and vertical retaining feature).
- 2. Natural vegetated headwall is to be built as per the manufacturer's specification.
- Headwall to be treated with hydroseeding or live planting.
- 4. The first pipe joint shall be flexible and located not more than 300mm from the back of the headwall.
- 5. Distance between the edge of headwall and footway/carriageway to be 1m minimum.
- 6. For pipes 450mm dia. and above, a pipe mounted hinge grating is required.
- Liaison with LLFA and LPA required.

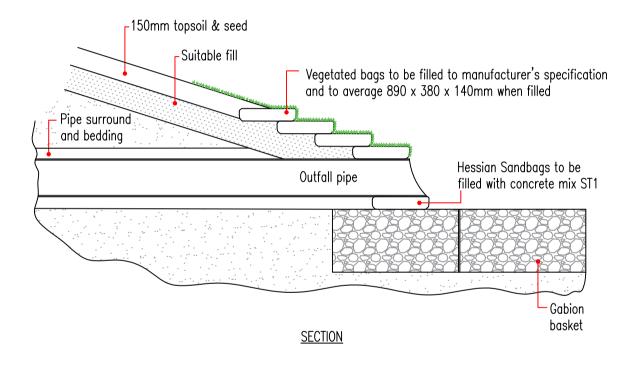

Suffolk County Council

Growth, Highways & Infrastruture Suffolk County Council Endeavour House 8 Russell Road Ipswich Suffolk IP1 2BX DRAWING TITLE

DRAINAGE AND SERVICE DUCTS
NATURAL VEGETATED HEADWALL

1	REV.	DESCRIPTION	CHECKED	DATE
	Α	MINOR CHANGES IN NOTES	СВ	11/2025
ı				
ļ				

	INIT.	DATE	PROJECT TITL	_
ORIGINATOR	RY	08/2024	STANDARD CONSTRUCTION DETAILS	
CHECKER	SH	08/2024	SCALE	DATE
DESIGNER	RY	08/2024	N.T.S. DRAWING No.	AUG. 2024
REVIEWER	TK	08/2024		