


SECTION A-A

DIM. X VARIES TO 1050, 1200, 1500 or 1800 as specified in Appendix 5/1

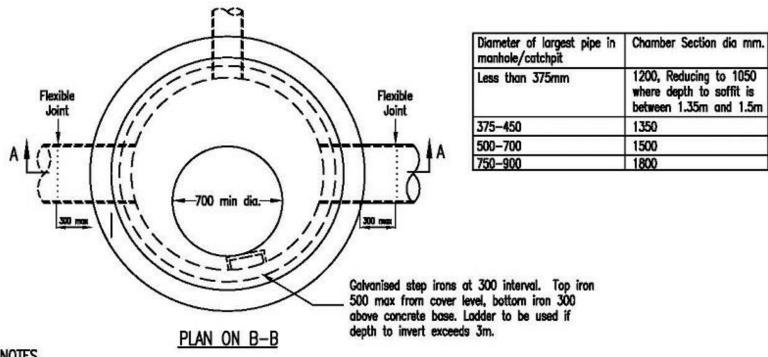

NOTES

- 1. All dimensions in millimetres.
- 2. Manhole cover or grating as detailed in the specification.
- 3. Heavy duty precast cover slab placed with opening away from traffic wherever possible.
- 4. Where catchpits are constructed in the carriageway the top of the slab will be at formation level and the depth between the slab and frame will be constructed in engineering brickwork. Elsewhere up to 3 courses may be used.
- 5. Taper and shaft rings may be used provided bottom of taper is a minimum of 1.8m above concrete base.
- 6. Number of pipe openings to be as detailed in the specification.
- 7. All carrier pipes shall have the same soffit level unless detailed otherwise in the specification.
- 8. A minimum clear opening in cover to be: rectangular 700mm across the diagonal, circular 700mm diameter, triangular - 700mm diameter - See also drawing number 7/107.

	St	ル	ŀΟ	LK	COUNTY COUNCIL		
Revisions	Date	Inl.	No.	IIILE		Drawn WS	Ch'd.
Redrawn	03/04	J.G.	В		OATOUDITO	Ex'd.	App'd.
					CATCHPITS	Scale NTS	Date 5/02
						Drg. No. 7	/103B
				Director	r of Environment & Transport	****	