


When the shared surface road is taken from a road with footways, the footways shall be extended past the top of the ramp 1.8m. A pram crossing (PC) will also be required on the radius as shown.

NOTES: Bed granite setts in mortar to fill voids when setts laid.
Maximum thickness of mortar joints, 12mm.

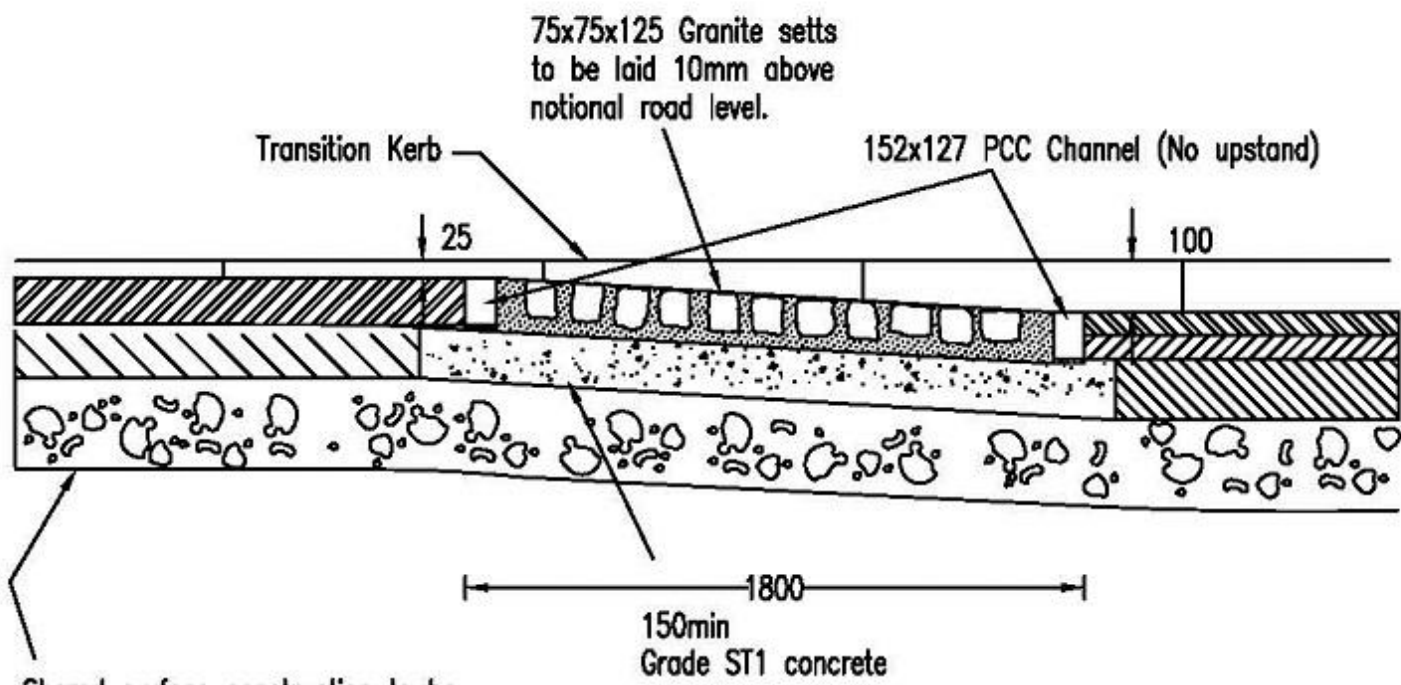

Shared surface construction to be block paving (See Table 9/1 for construction thickness). A pair of gullies to be provided top or bottom of ramp depending on road levels.

SUFFOLK COUNTY COUNCIL

Revisions	Date	Inl.	No.	TITLE RAMP DETAIL SHARED SURFACE ROAD	Drawn	WS	Ch'd.	
New Issue			A		Ex'd.		App'd.	
Title block & drawing amended.	03/04	J.G	B		Scale	N.T.S.	Date	5/02
					Drg. No.	10/105B		

Director of Environment & Transport